




1 RISER - WET AND DRY SYSTEMS  
SCALE: N.T.S.

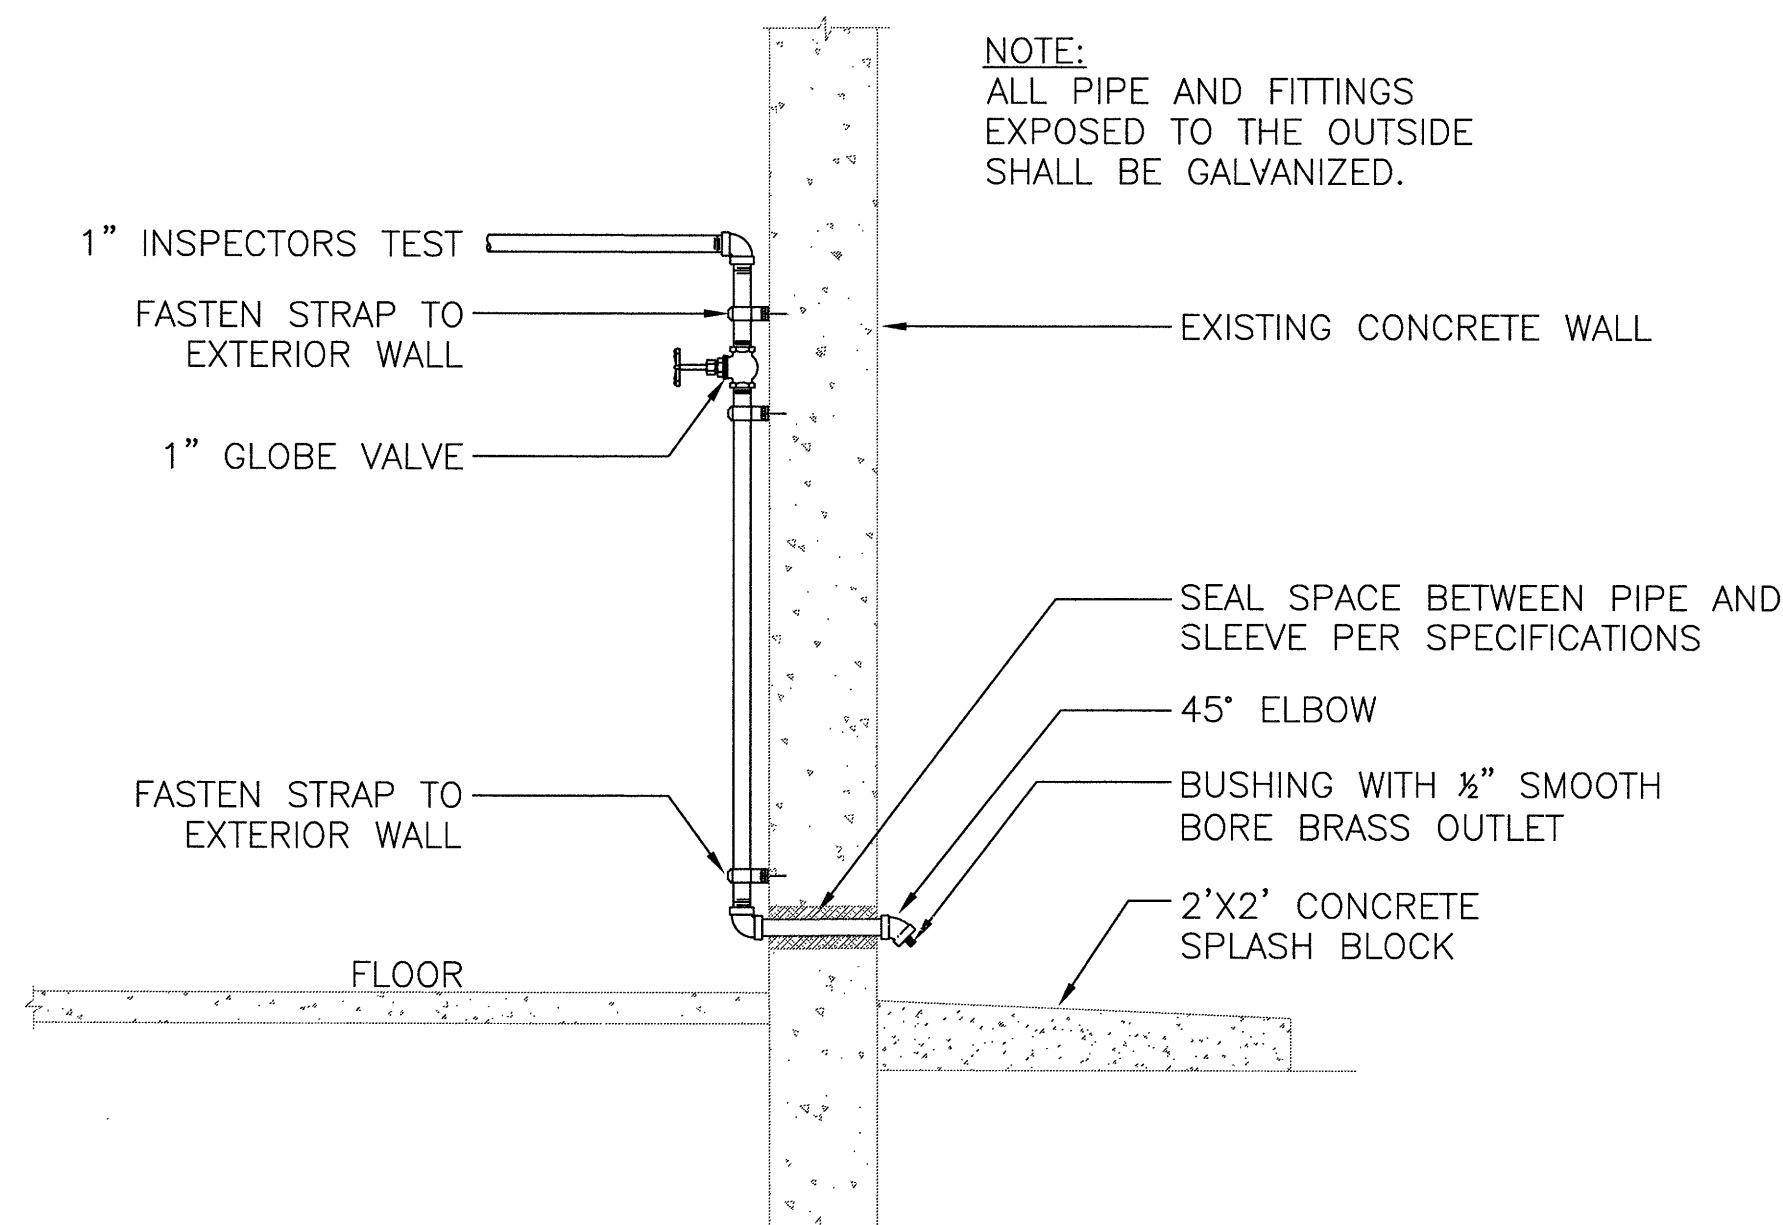


2 WET SYSTEM INSPECTOR'S TEST CONNECTION  
SCALE: N.T.S.

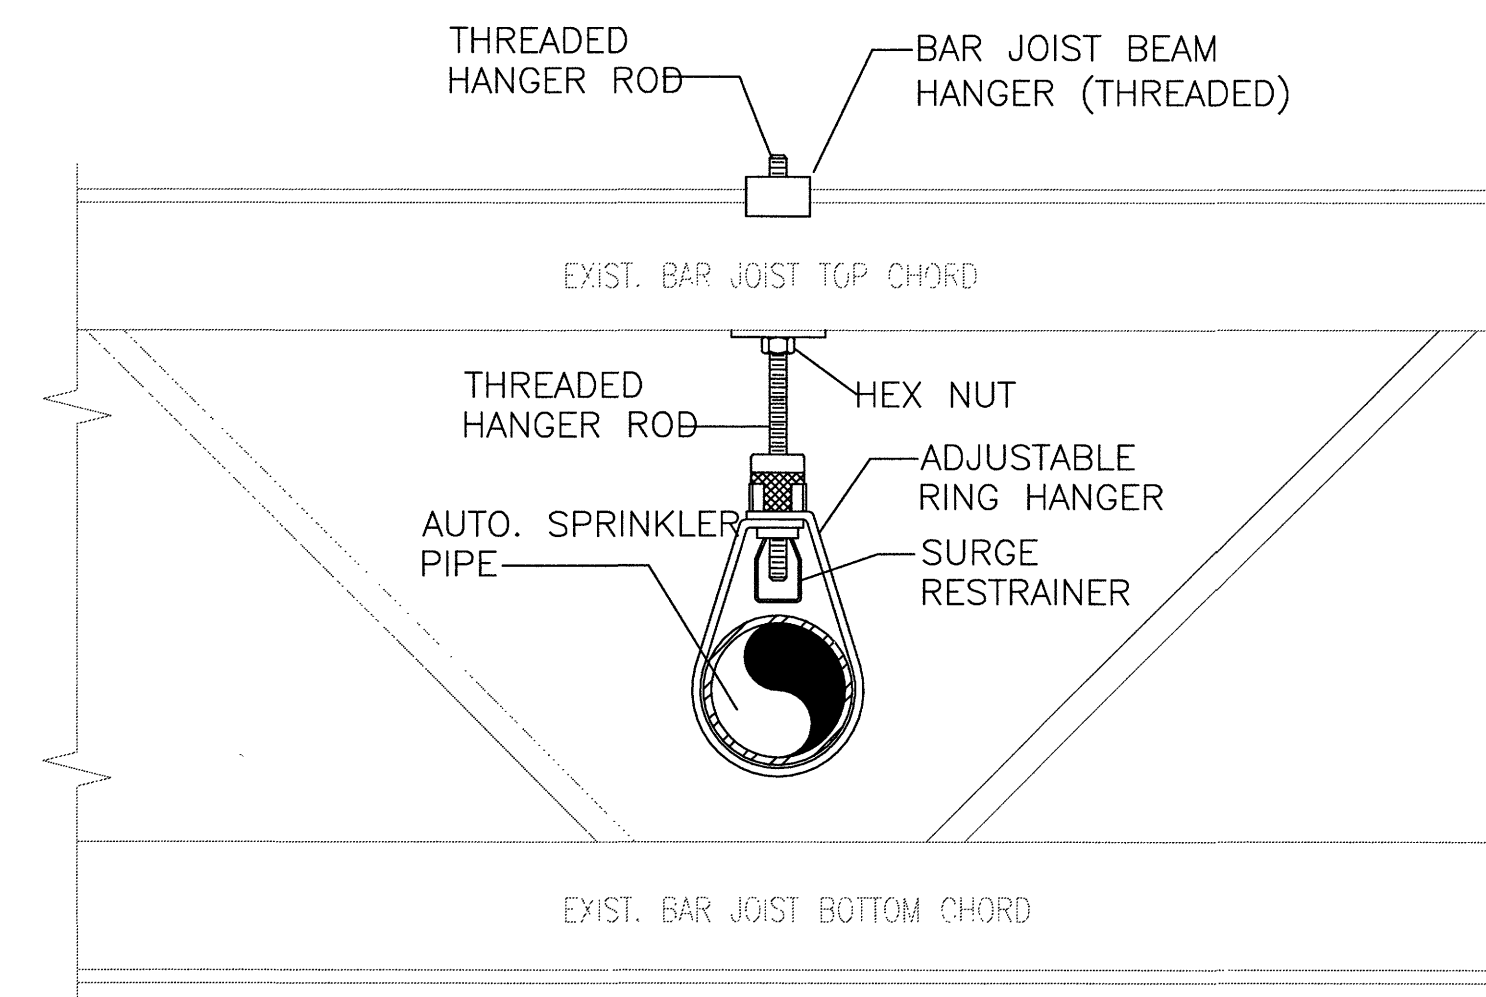


3 BAR JOIST BEAM HANGER WITH THREADED HOLE  
SCALE: N.T.S.

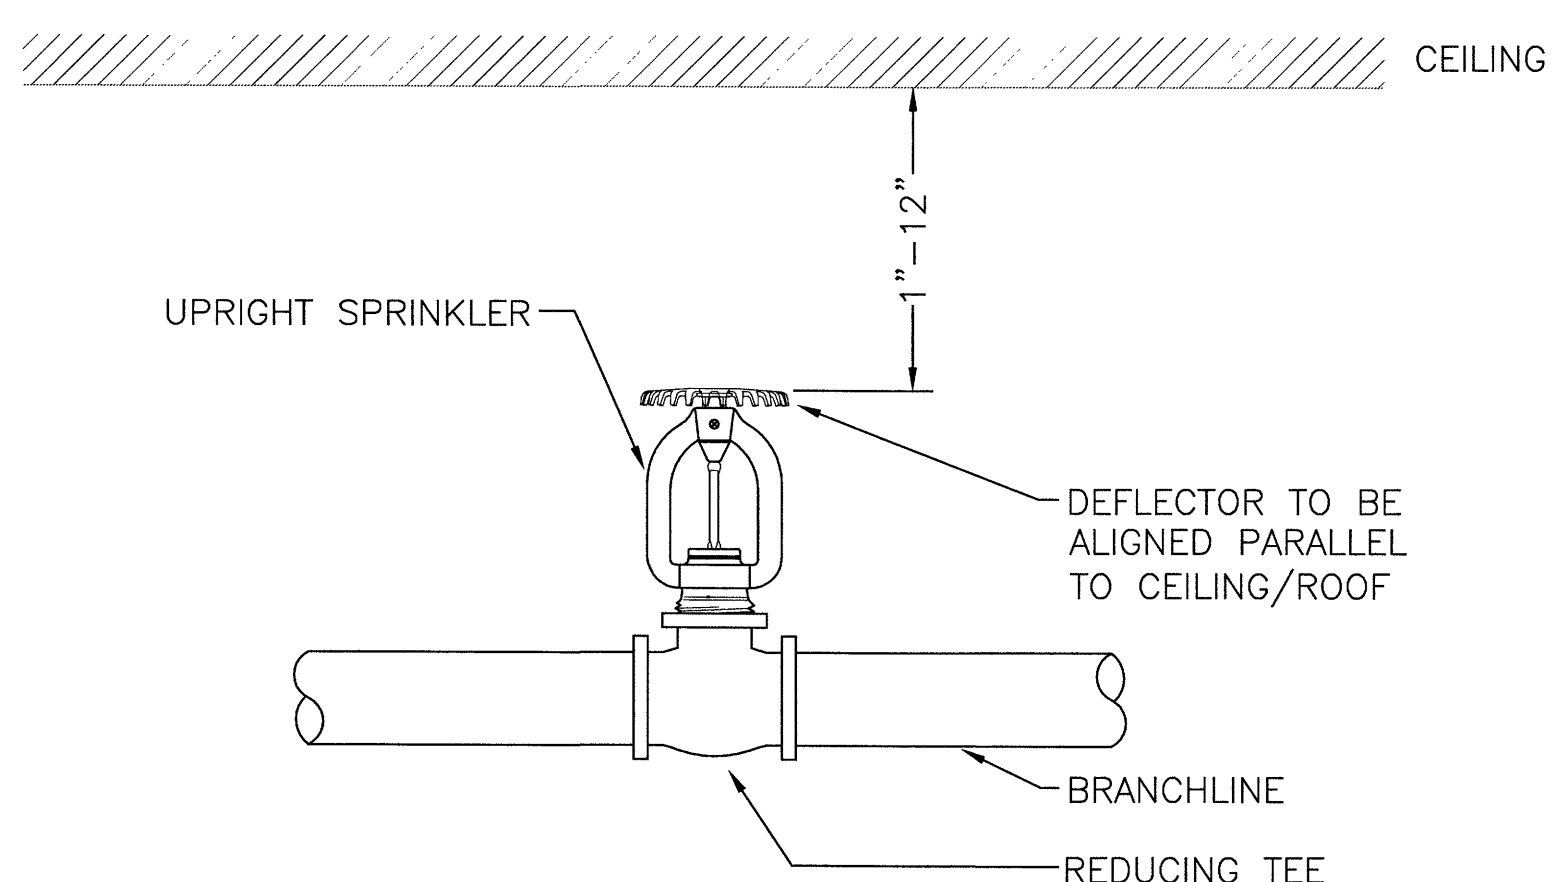

4 UPRIGHT SPRINKLER  
SCALE: N.T.S.

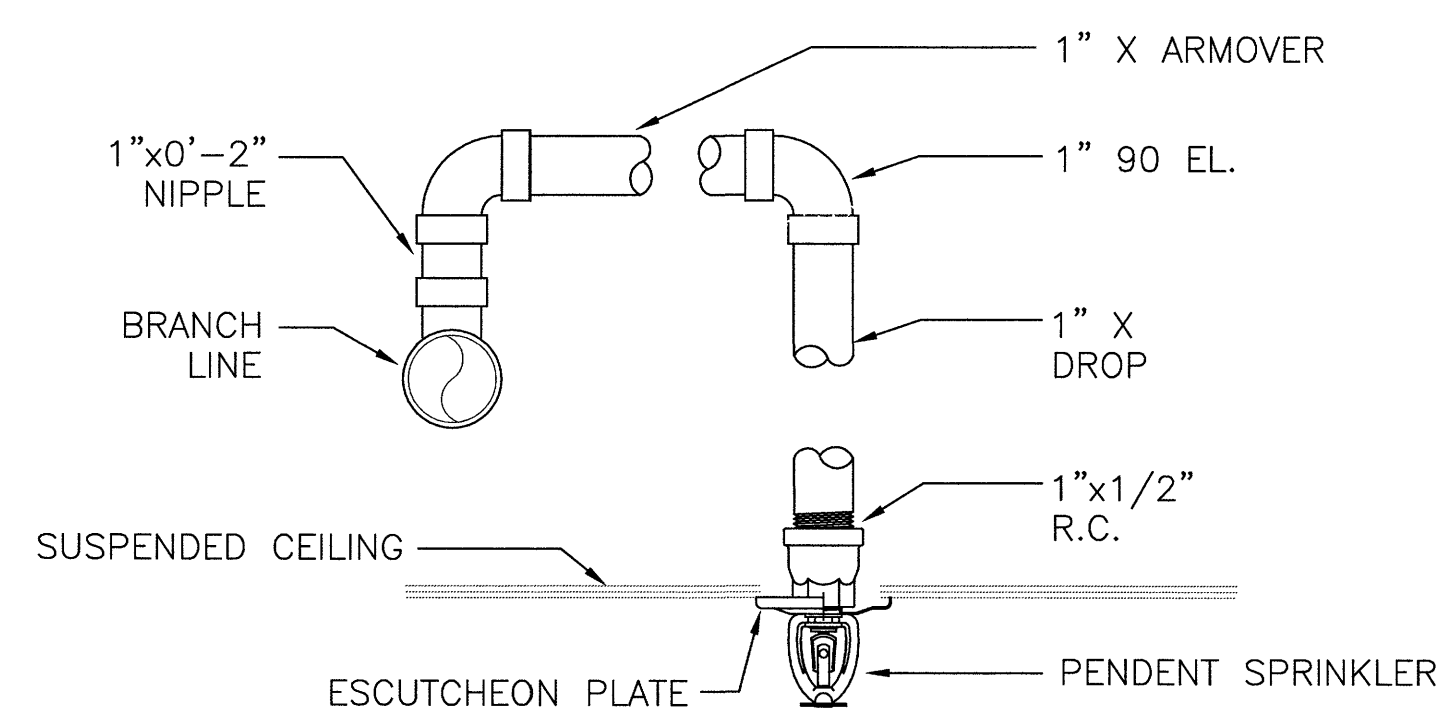

5 TYPICAL PENDENT SPRINKER  
SCALE: N.T.S.

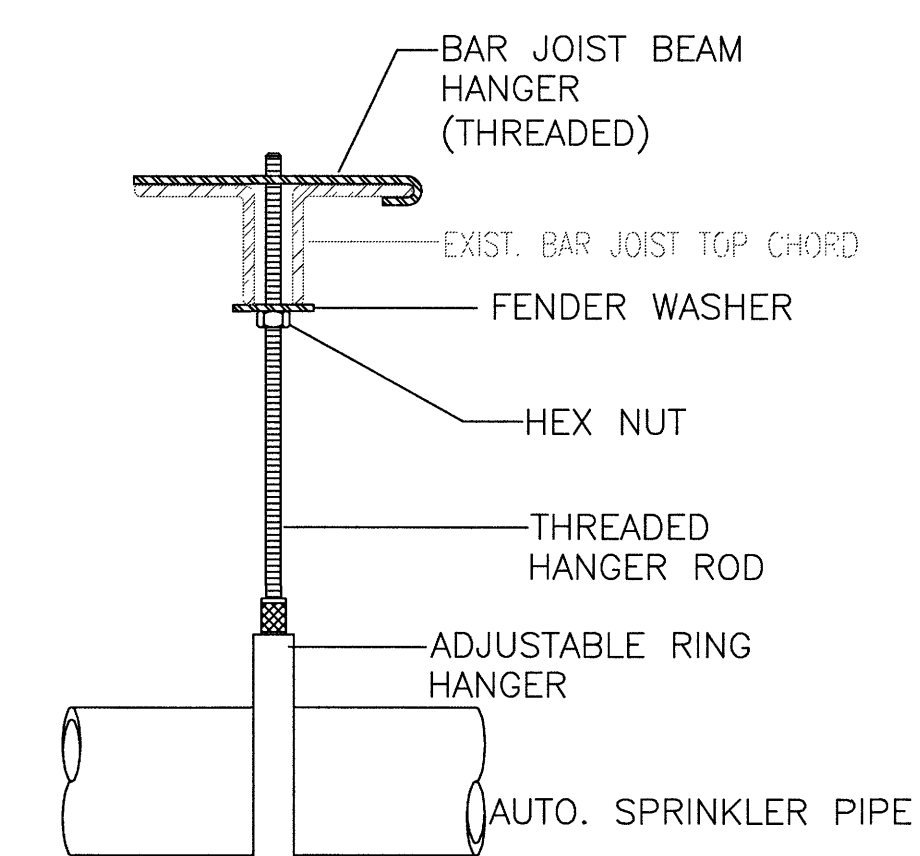


6 BAR JOIST BEAM HANGER SUPPORT  
SCALE: N.T.S.



ENGINEERS  
ARCHITECTS  
PLANNERS

449 McLaws Circle  
Williamsburg, VA 23185  
(757) 253-0673 VOICE  
(757) 253-2319 FAX

www.djginc.com

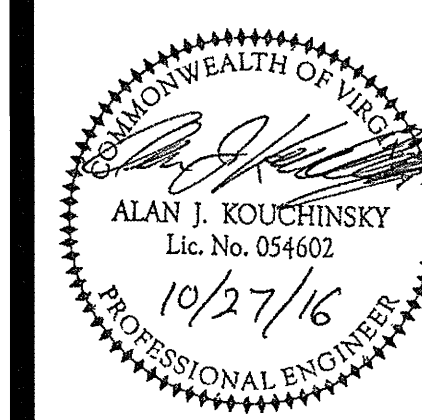

COUNTY OF ALBEMARLE

PANTOPS  
PUBLIC SAFETY  
FACILITY

IFB # 2017-11223-20

CHARLOTTESVILLE,  
VIRGINIA

REVISIONS

NO.	DATE	DESCRIPTION

DATE DESCRIPTION

COMMISSION NUMBER

2160310

SCALE: AS NOTED

DESIGNED: JEK

DRAWN: JEK

CHECKED: AAK

DATE: 10.27.2016

THIS DOCUMENT CONTAINS INFORMATION PROPRIETARY TO DJG, INC. AND IS FURNISHED IN CONFIDENCE AS AN INSTRUMENT OF SERVICE FOR THE LIMITED PURPOSE OF EVALUATION, DESIGN AND REVIEW. REPRODUCTION OR THE MODIFICATION OF ANY DETAIL OR DESIGN WITHOUT THE EXPRESSED WRITTEN CONSENT OF DJG, INC. IS PROHIBITED. ALL RIGHTS RESERVED. COPYRIGHT DJG, INC. (C) 2016.

SHEET TITLE

FIRE PROTECTION  
DETAILS

SHEET NUMBER

F-501

67 OF 68